


[REDACTED] (12/01/2023)

## Written Fuel Summary Report

### Tank 1 -Off Bottom

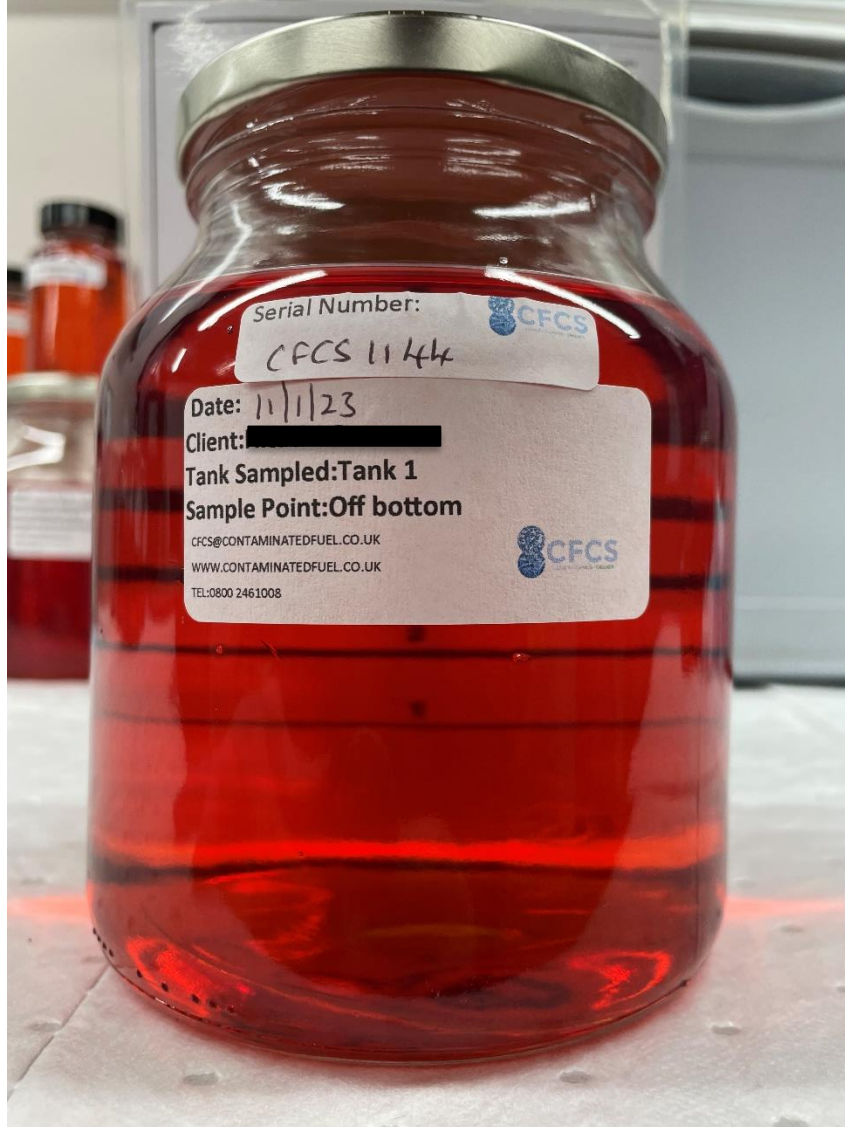

Clear and bright to ASTM D4176, no free water, no debris, no MBG, moisture content <200PPM, ISO 4406 19/17/12, flashpoint >55, FAME 0.08%, cetane 49.3, density 827, ATP Test 0 RLU's, DCI 50.72, cloudpoint -11.1, FBT 1.02, Viscosity @40c 2.2.

**Fuel is within specification on tests performed for fuel supply.**  
**ISO 4406 particulate count elevated above recommended.**

Contact: **0800 246 1008** | [cfcs@contaminatedfuel.co.uk](mailto:cfcs@contaminatedfuel.co.uk)

CFCS | Clement Cottage | Gwern-Y-Brenin | Oswestry | Shropshire | SY10 8AP

VAT Reg No: 207 855 691

Company Reg No: 94315671

---


[REDACTED] (12/01/2023)

Written Fuel Summary Report

---

**Notation**

A bottom sample was obtained as a reference. A picture of this can be seen below.

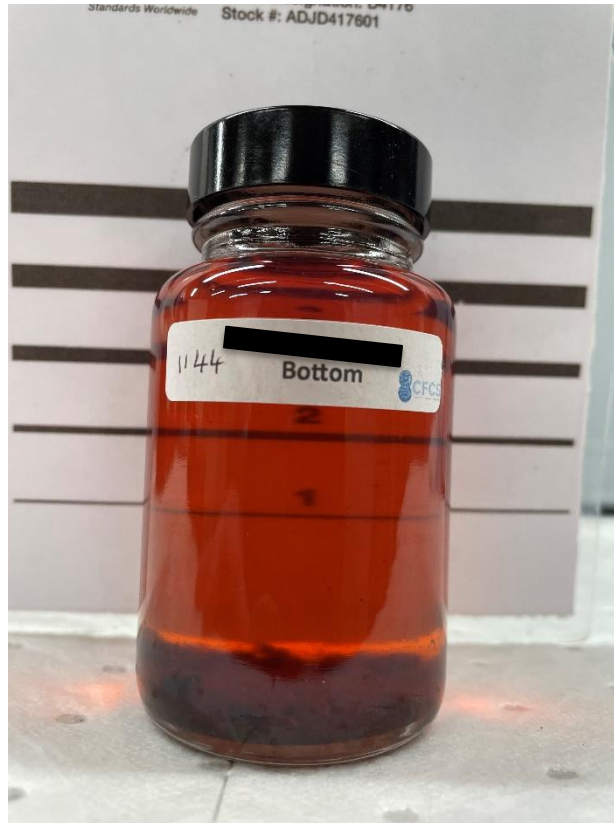

The sample has minimal evidence of free water in the formation of droplets and some debris and MBG.